

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/pera

DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY AFFAIRS (PERA) BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

Eco Window Systems, LLC 7955 NW 77th Avenue Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Eco-Guard - 200" Aluminum Horizontal Rolling Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. **W09-12**, titled "Eco-Guard Series-200 Alum. Horiz. Rolling Wdw. (L.M.I.)" sheets 1 through 7 of 7, dated 02/24/09, with revision B dated 01/31/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # 09-0312.08 and consists of this page 1 and evidence pages E-1 E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.

MIAMIDADE COUNTY
APPROVED

W 4/13/12

NOA No. 12-0221.05 Expiration Date: May 27, 2014 Approval Date: April 26, 2012 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

- 1. Manufacturer's die drawings and sections.
- 2. Drawing No. W09-12, titled "Eco-Guard Series-200 Alum. Horiz. Rolling Wdw. (L.M.I.)" sheets 1 through 7 of 7, dated 02/24/09, with revision B dated 01/31/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

- 1, Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of a XOX aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-08-2226A**, dated 01/15/09, signed and sealed by Candido F. Font, P.E.

(Submitted under previous NOA#09-0312.08)

- 2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
 - 2) Cyclic Wind Pressure Loading per FBC, TAS 203-94 along with marked-up drawings and installation diagram of a XOX aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-08-2226B**, dated 01/15/09, signed and sealed by Candido F. Font, P.E.

(Submitted under previous NOA#09-0312.08)

3. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94 along with marked-up drawings and installation diagram of a XOX aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-08-2227**, dated 01/15/09, signed and sealed by Candido F. Font, P.E.

(Submitted under previous NOA#09-0312.08)

- 4. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of a XOX aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-08-2228A**, dated 01/15/09, signed and sealed by Candido F. Font, P.E.

(Submitted under previous NOA#09-0312.08)

Manuel Perez, P.E. Product Control Examiner NOA No. 12-0221.05

Expiration Date: May 27, 2014 Approval Date: April 26, 2012

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)

5. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a XOX aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-08-2228B**, dated 01/15/09, signed and sealed by Candido F. Font, P.E.

(Submitted under previous NOA#09-0312.08)

6. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a XOX aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. HETI-08-2229, dated 01/15/09, signed and sealed by Candido F. Font, P.E.

(Submitted under previous NOA#09-0312.08)

7. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a XOX aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-08-2230A**, dated 01/15/09, signed and sealed by Candido F. Font, P.E.

(Submitted under previous NOA#09-0312.08)

8. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a XOX aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. HETI-08-2230B, dated 01/15/09, signed and sealed by Candido F. Font, P.E.

(Submitted under previous NOA#09-0312.08)

C. CALCULATIONS

- 1. Anchor verification calculations and structural and comparative analysis prepared by Al-Farooq Corporation, complying with FBC-2010, dated 01/27/12, signed and sealed by Javad Ahmad, P.E.
- 2. Glazing complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Department of Permitting, Environment, and Regulatory Affairs (PERA)

Manuel Perez P.E.
Product Control Examiner

NOA No. 12-0221.05 Expiration Date: May 27, 2014

Approval Date: April 26, 2012

Eco Windows Systems, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

- 1. Notice of Acceptance No. 11–0624.02 issued to E.I. DuPont DeNemours & Co., Inc. for their "DuPont SentryGlas® Interlayer" dated 08/25/11, expiring on 01/14/17.
- 2. Notice of Acceptance No. 11-0624.01 issued to E.I. DuPont DeNemours & Co., Inc. for their "DuPont Butacite® PVB Interlayer" dated 09/08/11, expiring on 12/11/16.

F. STATEMENTS


- 1. Statement letter of conformance, complying with FBC-2010, and of no financial interest, dated January 30, 2012, signed and sealed by Javad Ahmad, P.E.
- Proposal No. 08-1490 issued by BCCO, Product Control, dated October 08, 2008, signed by Renzo Narciso, P. E.
 (Submitted under previous NOA#09-0312.08)

G. OTHER

1. Notice of Acceptance No. **09-0312.08**, issued to Eco Window Systems, LLC. for their "Eco-Guard Series-200" Aluminum Horizontal Rolling Window – L.M.I., approved on 05/27/09 and expiring on 05/27/14.

Manuel Perez, P.E. Product Control Examiner NOA No. 12-0221.05

Expiration Date: May 27, 2014 Approval Date: April 26, 2012

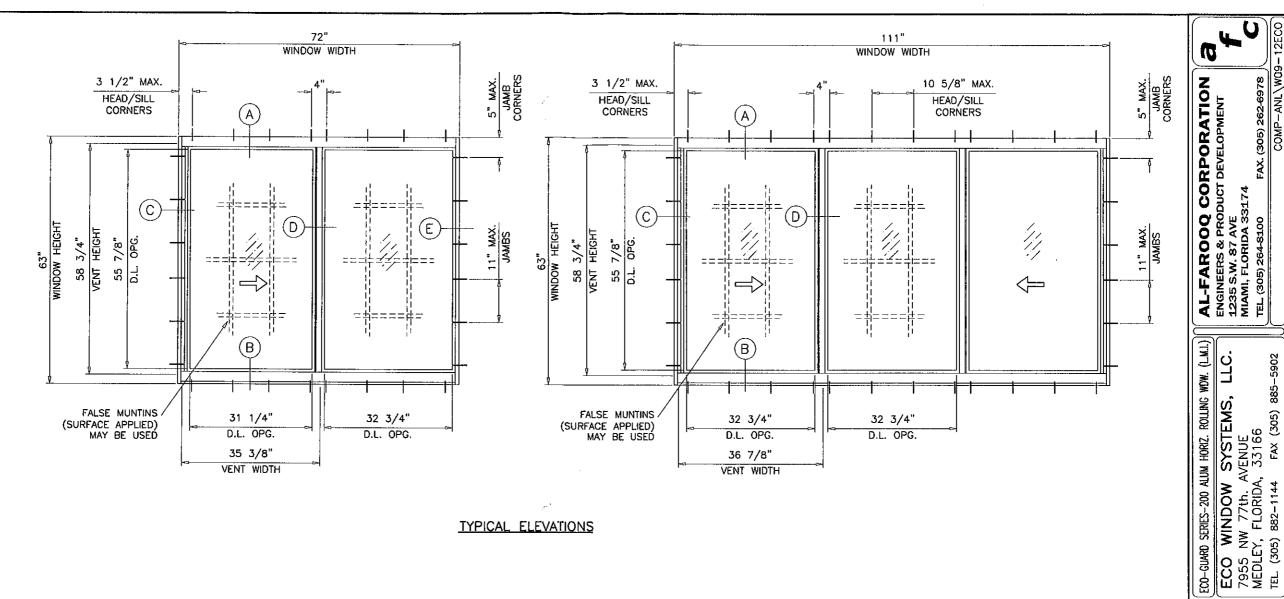

TYPICAL ELEVATIONS

ECO-GUARD SERIES-200 ALUMINUM HORIZONTAL ROLLING WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEETS 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF H.R./H.R. OR HORIZONTAL ROLLING WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS. THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

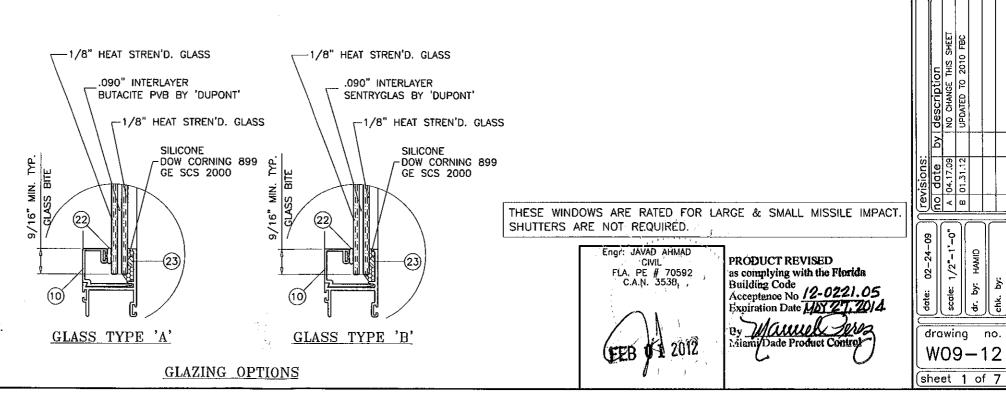

SYSTEMS,

DESIGN LOAD CAPACITY - PSF (XO, OX OR XX SIZES)						
			₩/0	REINF.	WITH	REINF.
WINDOW DIMS.		A	GLASS TYPE 'A' GLASS TYPE			'YPE 'B
WIDTH	HEIGHT		EXT.(+)	INT.()	EXT.(+)	INT.(-)
26-1/2"		4	70.0	80.0	80.0	90.0
37"	26"	4	70.0	80.0	80.0	90.0
53-1/8"	(3)	6	70.0	80.0	80.0	90.0
74"		8	70.0	80.0	80.0	90.0
26-1/2"		4	70.0	80.0	80.0	90.0
37"	38-3/8"	4	70.0	80.0	80.0	90.0
53-1/8"	(3)	6	70.0	80.0	80.0	90.0
74"		8	70.0	80.0	80.0	90.0
26-1/2"		4	70.0	80.0	80.0	90.0
37"	50-5/8"	4	70.0	80.0	80.0	90.0
53-1/8"	(4)	6	70.0	80.0	80.0	90.0
74"		8	70.0	80.0	80.0	90.0
26-1/2"		4	70.0	80.0	80.0	90.0
37"	63"	4	68.9	77.5	80.0	90.0
53-1/8"	(5)	6	70.0	70.0	80.0	90.0
74"		8	70.0	70.0	80.0	80.4
24"		4	70.0	80.0	80.0	90.0
36"		4	70.0	80.0	80.0	90.0
48"	24"	6	70.0	80.0	80.0	90.0
60"	(2)	6	70.0	80.0	80.0	90.0
72"		8	70.0	80.0	80.0	90.0
24"		4	70.0	80.0	80.0	90.0
36"		4	70.0	80.0	80.0	90.0
48"	36"	6	70.0	80.0	80.0	90.0
60"	(3)	6	70.0	80.0	80.0	90.0
72"		8	70.0	80.0	80.0	90.0
24"		4	70.0	80.0	80.0	90.0
36"	Ì	4	70.0	80.0	80.0	90.0
48"	48" (4)	6	70.0	80.0	80.0	90.0
60"	(4)	6	70.0	80.0	80.0	90.0
72"		8	70.0	80.0	80.0	90.0
24"		4	70.0	80.0	80.0	90.0
36"		4	70.0	80.0	80.0	90.0
48"	60" (5)	6	70.0	70.0	80.0	90.0
60"	(3)	6	70.0	70.0	80.0	90.0
72"	İ	8	70.0	70.0	80.0	87.6

A = NO. OF ANCHORS PER HEAD & SILL () = NO. OF ANCHORS PER JAMB




LEFT AND RIGHT VENTS TO BE OF EQUAL GLASS DLO WIDTHS

'XO OR OX'

DESIGN LOAD CAPACITY - PSF (XOX SIZES)						
				REINF.	WITH REINF.	
WINDO	W DIMS.	l A	GLASS ?	LALE , Y,		
WIDTH	HEIGHT		EXT.(+)	(-).דאו	EXT.(+)	INT.(-)
74"	26"	9	70.0	80.0	80.0	90.0
106-1/4"	(3)	12	70.0	80.0	80.0	90.0
111"	,-,	12	70.0	80.0	80.0	90.0
74"	38-3/8"	9	70.0	80.0	80.0	90.0
106-1/4"	(3)	12	70.0	80.0	80.0	90.0
111"	(0)	12	70.0	80.0	80.0	90.0
74"	50-5/8"	9	70.0	80.0	80.0	90.0
106-1/4"	(4)	12	70.0	80.0	80.0	90.0
111"	\''	12	70.0	80.0	80.0	90.0
74"	"	9	70.0	70.0	80.0	90.0
106-1/4"	63"	12	70.0	70.0	80.0	82.6
111"	(5)	12	70.0	70.0	80.0	80.4
72"		9	70.0	80.0	80.0	90.0
84"	24"	9	70.0	80.0	80.0	90.0
96"	(2)	12	70.0	80.0	80.0	90.0
108"		12	70.0	80.0	80.0	90.0
72"		9	70.0	80.0	80.0	90.0
84"	36"	9	70.0	80.0	80.0	90.0
96"	(3)	12	70.0	80.0	80.0	90.0
108"		12	70.0	80.0	80.0	90.0
72"		9	70.0	80.0	80.0	90.0
84"	48"	9	70.0	80.0	80.0	90.0
96"	(4)	12	70.0	80.0	80.0	90.0
108"		12	70.0	80.0	80.0	90.0
72"		9	70.0	70.0	80.0	90.0
84"	60"	9	70.0	70.0	80.0	90.0
96"	(5)	12	70.0	70.0	80.0	90.0
108"		12	70.0	70.0	80.0	87.6

A = NO. OF ANCHORS PER HEAD & SILL () = NO. OF ANCHORS PER JAMB




OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH

'xox'

DESIGN LOAD CAPACITY - PSF (XOX SIZES)							
			W/O REINF.		WITH REINF.		
WINDOV	Y DIMS.	A	GLASS '	rype 'a'	GLASS 1	GLASS TYPE 'B'	
WIDTH	HEIGHT	, ,	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
74"	26"	9	70.0	80.0	80.0	90.0	
106-1/4"	(3)	12	70.0	80.0	80.0	90.0	
111"	(4)	12	70.0	80.0	80.0	90.0	
74"	38-3/8"	9	70.0	80.0	80.0	90.0	
106-1/4"	(3)	12		_	80.0	90.0	
111"	(0)	12	-	_	80.0	90.0	
74"	50-5/8" (4)	9	70.0	80.0	80.0	90.0	
74"	63" (5)	9	70.0	70.0	80.0	90.0	
72"		9	70.0	80.0	80.0	90.0	
84"	24"	9	70.0	80.0	80.0	90.0	
96"	(2)	12	70.0	80.0	80.0	90.0	
108"		12	70.0	80.0	80.0	90.0	
72"		9	70.0	80.0	80.0	90.0	
84"	36"	9	70.0	80.0	80.0	90.0	
96"	(3)	12	70.0	80.0	80.0	90.0	
108"			_		80.0	90.0	
72"		9	70.0	80.0	80.0	90.0	
84"	48"	9	70.0	70.0	80.0	90.0	
96"	(4)	12	70.0	70.0	80.0	90.0	
72"	60" (5)	9	70.0	70.0	80.0	90.0	

A = NO. OF ANCHORS PER HEAD & SILL () = NO. OF ANCHORS PER JAMB



OPERATING VENTS TO BE 1/4 OF THE WINDOW WIDTH

'xox'

ALL EXTERIOR(+) LOADS SHOWN ON THIS SHEET ARE FOR WINDOWS WITH ADD-ON RISER AT FRAME SILL FOR STD. SILL (NO RISER) LIMIT EXT.(+) LOADS TO 67.0 PSF SEE SHEET 4 FOR DETAIL.

GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-04 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

FLA. PE # 70592 C.A.N. 3538

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 12-1 Expiration Date 146Y

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 262-6978

ECO-CUARD SERIES-200 ALUM HORZ. ROLLING WDW. (LM.1.)


ECO WINDOW SYSTEMS, LLC. 7955 NW 77th. AVENUE


MEDLEY, FLORIDA, 33166


TEL. (305) 882-1144 FAX (305) 885-5902


02-24-<u>.</u>

drawing no. W09 - 12sheet 2 of 7

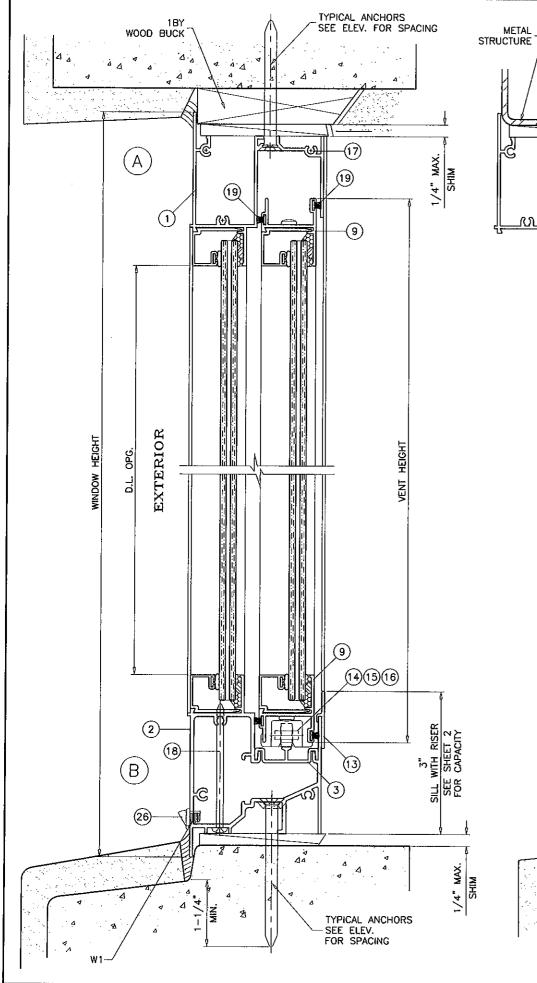








WEEPHOLES:

 $W1 = 3/8" \times 2-1/4"$ WEEPHOLES AT EACH END ÁND 37" O.C. MAX.

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH JOINT SEALER.

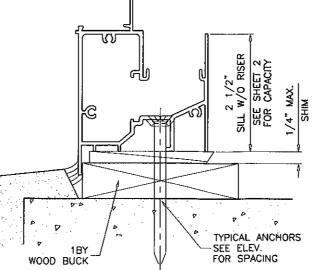

WOOD BUCKS AND METAL STRUCTURE NOT BY ECO WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)

1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES 1-3/8" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)

INTO METAL STRUCTURES

STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.) ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)


INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8") (NO SHIM SPACE)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN. INTO WOOD STRUCTURE = 1" MIN.

INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS I'C = 3000 PSI MIN. C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.



PRODUCT REVISED as complying with the Florida Building Code Acceptance No 12


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978


ECO-GUARD SERIES-200 ALUM HORIZ. ROLLING WDW. (L.M.I.) LC.


ECO WINDOW SYSTEMS, I 7955 NW 77th. AVENUE MEDLEY, FLORIDA, 33166 TEL (305) 882-1144 FAX (305) 885-


drawing no. W09 - 12


sheet 3 of 7

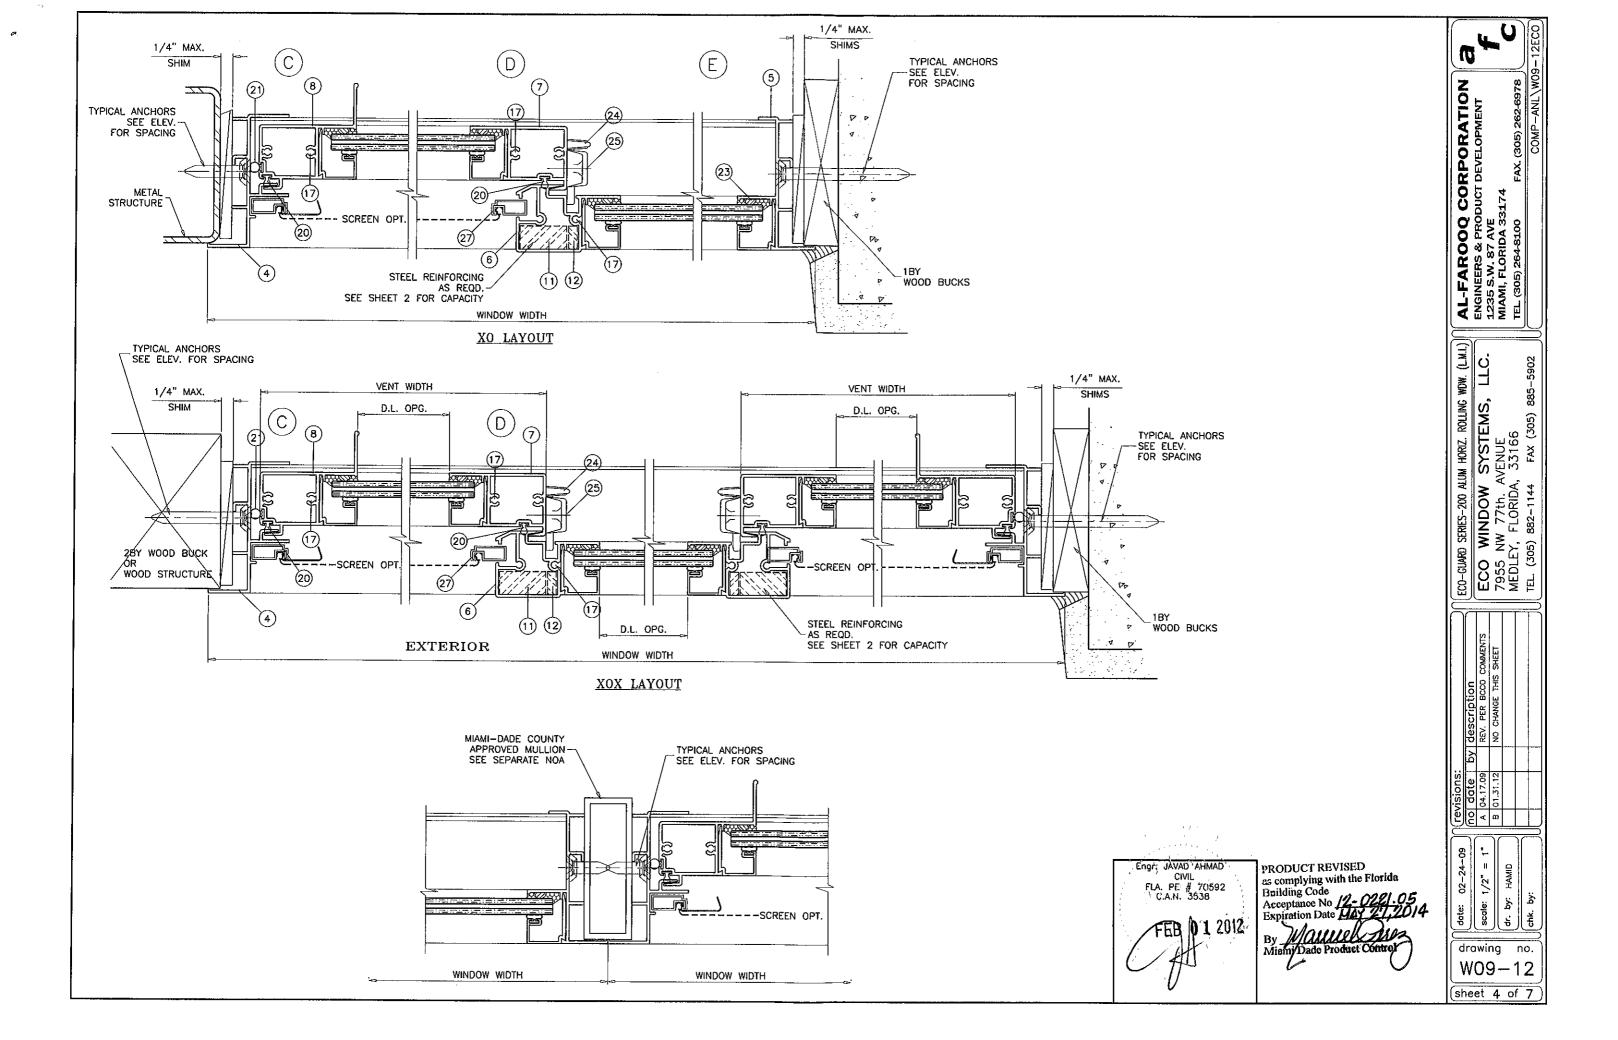


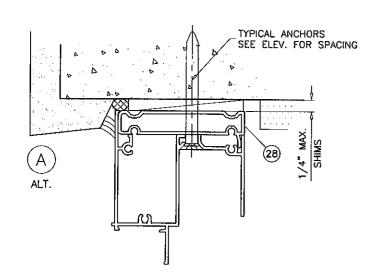



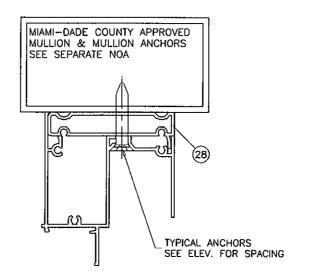

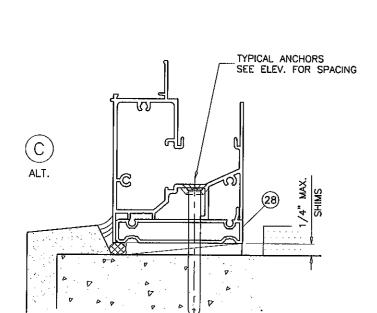

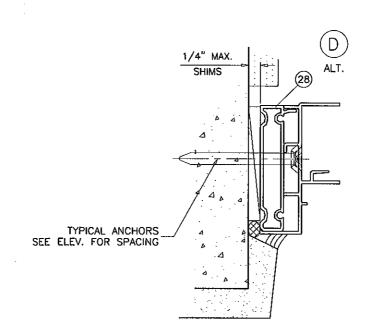

INSTALLATION DETAILS WITH FLUSH FRAME ADAPTER




PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No /2-022/. 05
Expiration Date Hay 277,2014
By Manual Susanipade Product Control

AL EADOOR CODDOATION	אבויסיים ליסיים	ENGINEERS & PRODUCT DEVELOPMENT	AZSO S.W. 87 AVE	¥7,7	TEL. (305) 264-8100 FAX. (305) 262-6978	COMP-ANL\W09
MOITA GOOD COMES, AND WIND HORIZ BOLLING WIND IN 19 11 LA BOARD CRAIKS, AND IN 19 11 LA BOARD CR	בכל סמינים שבוייבן במס הבטיוו וומאוב: ווסבבווים וומיו. (בייווין)	ECO WINDOW SYSTEMS, LLC.	7955 NW 77th AVENIE	MEDICY CLODIDA 22166	MEDELEI, TEORIOR, SOLOS	TEL. (305) 882-1144 FAX (305) 885-5902
3:	by description	9 NO CHANGE THIS SHEET	2 NO CHANGE THIS SHEET			

। द्वं |।

drawing no. W09 - 12sheet 5 of 7

FAX. (305) 262-697 COMP-ANL\

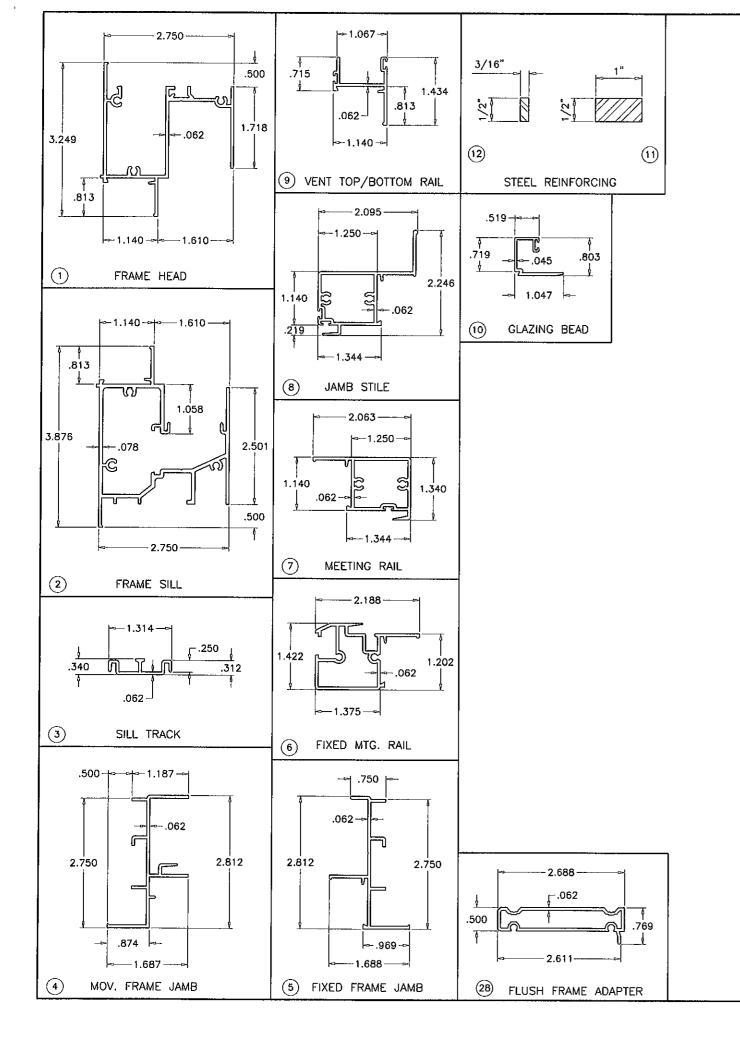

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	FY201	1	FRAME HEAD	6063-T6	_
2	FY202	1	FRAME SILL	6063-T6	
3	FY203	1	SILL TRACK INSERT	6063-T6	_
4	FY205	AS REQD.	MOV. FRAME JAMB	6063-T6	-
5	FY101	AS REQD.	FIXED FRAME JAMB	6063-T6	-
6	FY104	1/ VENT	FIXED MTG. RAIL	6063-T6	-
7	FY105	1/ VENT	VENT INTERLOCK	6063-T6	_
8	FY206	1/ VENT	JAMB STILE	6063-T6	-
9	FY107	2/ VENT	TOP AND BOTTOM RAIL	6063-T6	-
10	FY108	AS REQD.	GLAZING BEAD	6063-T6	_
11	-	AS REQD.	REINFORCING BAR	STEEL	-
12	_	AS REQD.	REINFORCING BAR	STEEL	-
13	FY204	AS RTEQD.	ADD-ON SILL RISER	6063-T6	USE AS REQD.
14	FY208	4/ VENT	ROLLER HOUSING & GUIDE	CELCON	-
15	FY209	2/ VENT	ROLLER	BRASS	-
16	FY210	2/ VENT	ROLLER PIN	ST. STEEL	-
17	#8 X 1"	AS REQD.	FRAME/VENT ASSEMBLY SCREWS	CRS	P.H. SMS
18	#8 X 3"	2/ VENT	FIX. RAIL SILL SCREWS (SILL END)	CRS	P.H. SMS
19	W23181	AS REQD.	FIN SEAL W'STRIPPING	-	ULTRAFAB
20	Q300T190	AS REQD.	BULB SEAL	Q-LON	SCHLEGEL
21	E207	AS REQD.	BULB SEAL	SANTOPRENE	ULTRAFAB, DUROMETER 65±5
22	E203	AS REQD.	GLAZING BEAD BULB	SANTOPRENE	ULTRAFAB, DUROMETER 65±5
23	FLB-50	AS REQD.	GLASS SPACER	SILICONE	FRANK LOWE
24	SL203P	2/ VENT	SWEEP LATCH	-	SULLIVAN & ASSOC.
25	#8 X 1/8"	2/ LATCH	LATCH INST. SCREW	ST. STEEL	OH SMS
26	WA2L	2/ WDW.	WEEP VALVE	-	PREFERRED ENG. PRODUCTS
27	<u>-</u>	1/ VENT	5/16" BOX SCREEN		OPTIONAL
28	FY120	-	FLUSH FRAME ADAPTER	6063-T6	OPTIONAL

Engr: JAVAD AHMAD CIVIL FLA. PE # 70592 C.A.N., 3558 FEB 0 1 2012

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0221. 05
Expiration Date Hay 212014


By Manual Succession of the Product Control


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978 (-14.1)

FCO-GUARD SFRIFS-200 ALIM HORIZ ROLLING WIDW (L.M.		ITS ECO WINDOW SYSTEMS, LLC.	7 147/ A 725 MM 7304	MEDIEY FLORIDA 33168		TEL. (305) 882-1144 FAX (305) 885-5902
	by description	REV. PER BCCO COMMENTS	UPDATED TO 2010 FBC			
revisions:	no date	A 04.17.09	B 01.31.12			
يح	71		7/	_	1	\dashv
dote: 02-24-09		scale: 1/2" = 1"		dr. by: HAMID		chk. by:


drawing no. W09 - 12

sheet 6 of 7

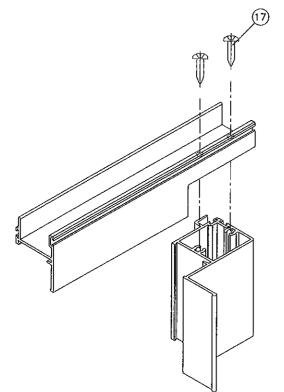

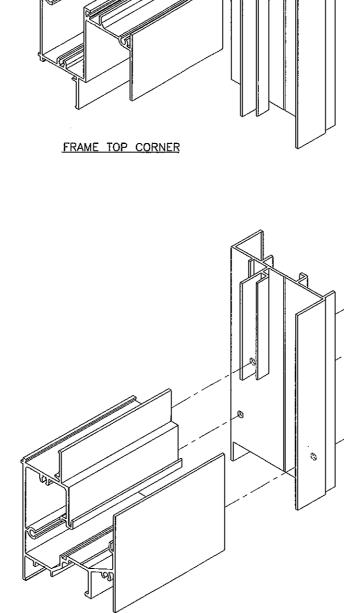


FRAME BOTTOM CORNER




PRODUCT REVISED as complying with the Florida Building Code Acceptance No 12-0221. C Expiration Date 144 27.2

date: 02-24-09	scale: 1/2" = 1"	dr. by: HAMID	chk. by:			
H	drawing no.					
W09-12						

revisions:
no date
A 04.17.09
B 01.31.12

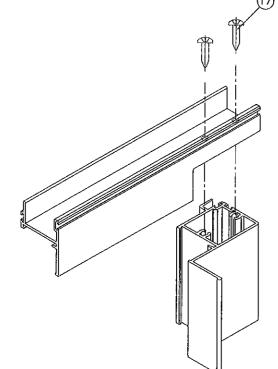

VENT TOP/BOTTOM CORNERS

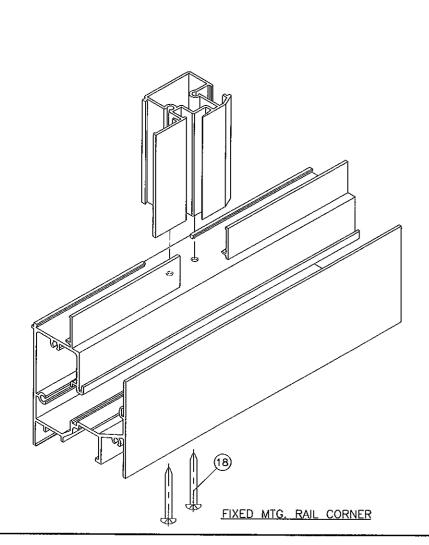



ECO-GUARD SERIES-200 ALUM HORIZ. ROLLING WDW. (L.M.I.)

ECO WINDOW SYSTEMS, LLC.

7955 NW 77th. AVENUE

MEDLEY, FLORIDA, 33166

TEL. (305) 882-1144 FAX (305) 885-5902

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX. (305) 262-6978